


FRASER COAST REGIONAL COUNCIL



SWIM DRDMW KPI DATA

2022-2023

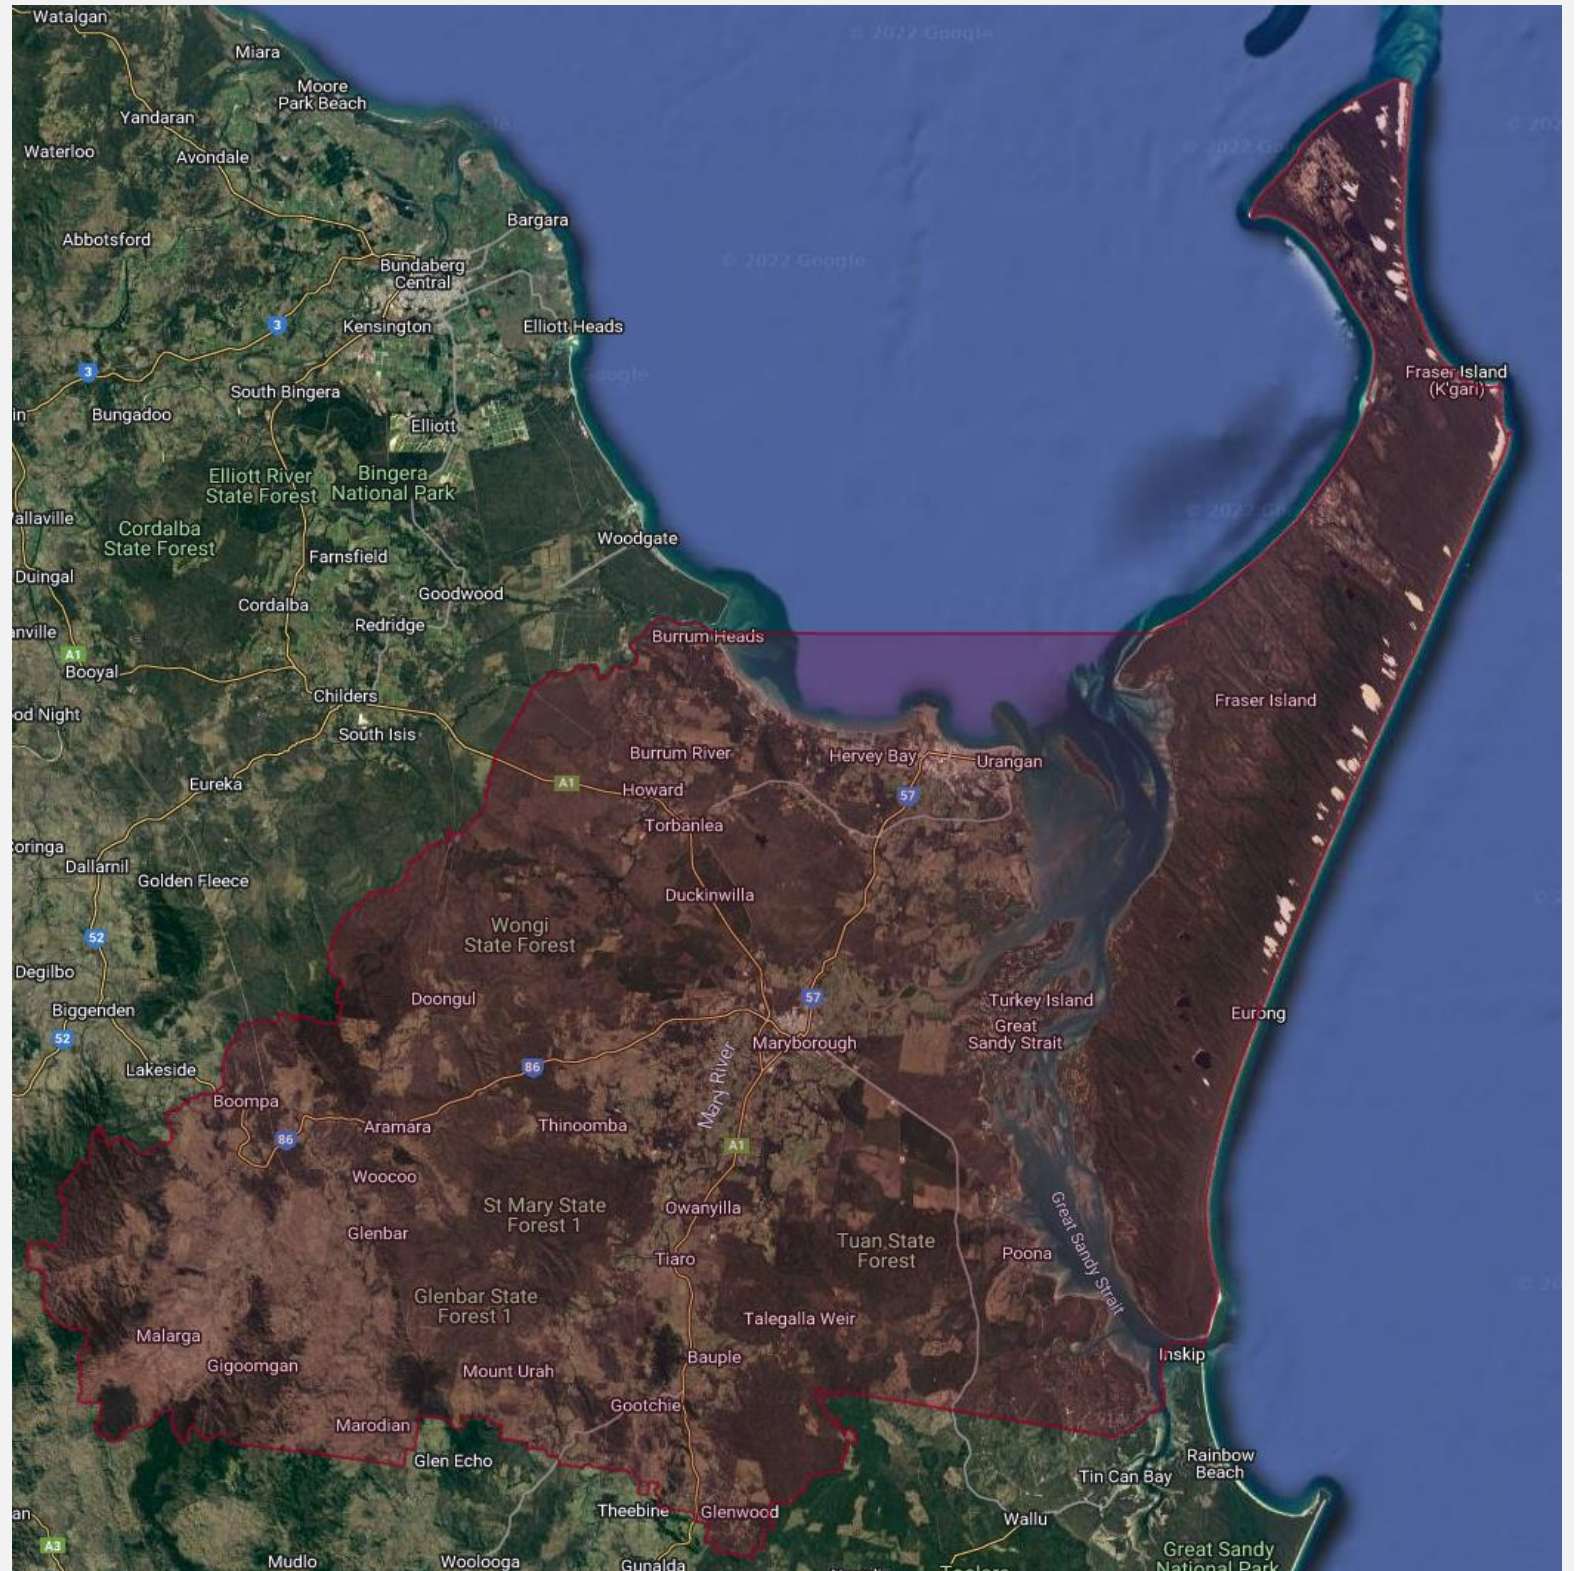

HERVEY BAY DRINKING WATER SCHEME							
Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.4a	AS1	Number water treatment plants: providing full treatment	2	Count
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.1	AS2	Length water mains	850.5	km
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.4b	AS47	Capacity of water treatment plants	54	ML/day
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.7	AS48	Total potable water storage volume	76.52	ML
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.23	AS56	Volume water lost: potable water	534.9	ML
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG4.5	AS8	Water main breaks per 100 km water main	8.6	per 100 km water main
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG4.12	CS10	Water service complaints per 1000 connections	8.5	per 1000 connections
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG4.14	CS12	Water and sewerage billing and account complaints per 1000 connections	0	per 1000 connections
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG4.11	CS13	Water and sewerage complaints (all) per 1000 connections	10.4	per 1000 connections
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG4.7	CS17	Average frequency unplanned interruptions: water	35.7	per 1000 connections
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.13	CS2	Connected residential properties: water	28.714	000s
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.14	CS3	Connected non-residential properties: water	2.318	000s
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG4.8a	CS66	Percent CSS response target met: water incidents	100	%
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG4.10	CS9	Water quality complaints per 1000 connections	1.6	per 1000 connections
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG4.1(value)	PR3	Fixed charge: water value	520.8	\$/annum
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG4.1(text)	PR5	Fixed charge: water description	Water Access	Text

HERVEY BAY DRINKING WATER SCHEME

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.8	WA1	Volume water sourced: surface water	7352.7	ML
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.9a	WA2	Volume water sourced: groundwater	NR	ML
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.5	WA201	Maximum daily demand	24.9	ML/day
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.21	WA223	Volume all water imported: internal and external	0	ML
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.22	WA224	Volume all water exported: internal and external	0	ML
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.6a	WA225	Volume potable water produced at a water treatment plant	6933.9	ML
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.17a	WA32	Volume potable water supplied: residential	4703.1	ML
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.18a	WA34	Volume potable water supplied: non-residential	1553.2	ML
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.10	WA61	Volume water sourced: desalination marine water	NR	ML
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG1.12	WA7	Volume water sourced: all	7352.7	ML

HERVEY BAY DRINKING WATER SECURITY							
Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.10a	WS11	Water restriction duration: PWCM	0	days
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.10b	WS12	Water restriction duration: Level 1	365	days
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.10c	WS13	Water restriction duration: Level 2	0	days
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.10d	WS14	Water restriction duration: Level 3	0	days
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.10e	WS15	Water restriction duration: Level 4	0	days
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.10f	WS16	Water restriction duration: Level 5	0	days
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.11a	WS17	Has asset management planning been undertaken in the last 10 yrs?	yes	yes/no
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.11b	WS18	Has drought management planning been undertaken in the last 10 yrs?	yes	yes/no
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.11c	WS19	Has water demand forecasts been developed or reviewed in the last 5 yrs?	yes	yes/no
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.11d	WS20	Has assessment of key capacity constraints of water infrastructure been undertaken in last 10 yrs?	yes	yes/no
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.11e	WS21	Has the timing for potential future supply augmentation been assessed in the last 10 yrs?	yes	yes/no
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.12	WS22	Months water supply remaining as at 30 June (KPI level)	5	1,2,3,4,5,6
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.13	WS23	Confidence water demand will be met: next 18 mths	high	high,fair,unsure,low,very low
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.14	WS24	Confidence water demand will be met: next 5 yrs	fair	high,fair,unsure,low,very low
2023	Hervey Bay Town Potable Water Supply Area	Potable water scheme	QG2.3	WS3	Available contingency supplies	yes	yes/no

MARYBOROUGH DRINKING WATER SCHEME							
Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.4a	AS1	Number water treatment plants: providing full treatment	1	Count
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.1	AS2	Length water mains	276.7	km
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.4b	AS47	Capacity of water treatment plants	18	ML/day
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.7	AS48	Total potable water storage volume	25.493	ML
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.23	AS56	Volume water lost: potable water	337.4	ML
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG4.5	AS8	Water main breaks per 100 km water main	5.4	per 100 km water main
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG4.12	CS10	Water service complaints per 1000 connections	4.6	per 1000 connections
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG4.14	CS12	Water and sewerage billing and account complaints per 1000 connections	0	per 1000 connections
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG4.11	CS13	Water and sewerage complaints (all) per 1000 connections	6.1	per 1000 connections
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG4.7	CS17	Average frequency unplanned interruptions: water	8	per 1000 connections
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.13	CS2	Connected residential properties: water	9.285	000s
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.14	CS3	Connected non-residential properties: water	1.248	000s
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG4.8a	CS66	Percent CSS response target met: water incidents	100	%
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG4.10	CS9	Water quality complaints per 1000 connections	1	per 1000 connections
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG4.1(value)	PR3	Fixed charge: water value	520.8	\$/annum
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG4.1(text)	PR5	Fixed charge: water description	Water Access	Text

MARYBOROUGH DRINKING WATER SCHEME

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.8	WA1	Volume water sourced: surface water	3119	ML
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.9a	WA2	Volume water sourced: groundwater	NR	ML
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.5	WA201	Maximum daily demand	12.2	ML/day
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.21	WA223	Volume all water imported: internal and external	0	ML
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.22	WA224	Volume all water exported: internal and external	0	ML
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.6a	WA225	Volume potable water produced at a water treatment plant	2481.5	ML
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.17a	WA32	Volume potable water supplied: residential	1463.9	ML
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.18a	WA34	Volume potable water supplied: non-residential	672.6	ML
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.10	WA61	Volume water sourced: desalination marine water	NR	ML
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG1.12	WA7	Volume water sourced: all	3119	ML

MARYBOROUGH DRINKING WATER SECURITY

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.10a	WS11	Water restriction duration: PWCM	0	days
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.10b	WS12	Water restriction duration: Level 1	365	days
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.10c	WS13	Water restriction duration: Level 2	0	days
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.10d	WS14	Water restriction duration: Level 3	0	days
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.10e	WS15	Water restriction duration: Level 4	0	days
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.10f	WS16	Water restriction duration: Level 5	0	days
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.11a	WS17	Has asset management planning been undertaken in the last 10 yrs?	yes	yes/no
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.11b	WS18	Has drought management planning been undertaken in the last 10 yrs?	yes	yes/no
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.11c	WS19	Has water demand forecasts been developed or reviewed in the last 5 yrs?	yes	yes/no
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.11d	WS20	Has assessment of key capacity constraints of water infrastructure been undertaken in last 10 yrs?	yes	yes/no
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.11e	WS21	Has the timing for potential future supply augmentation been assessed in the last 10 yrs?	yes	yes/no
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.12	WS22	Months water supply remaining as at 30 June (KPI level)	5	1,2,3,4,5,6
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.13	WS23	Confidence water demand will be met: next 18 mths	fair	high,fair,unsure,low,very low
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.14	WS24	Confidence water demand will be met: next 5 yrs	fair	high,fair,unsure,low,very low
2023	Maryborough Town Potable Water Supply Area	Potable water scheme	QG2.3	WS3	Available contingency supplies	yes	yes/no

TIARO DRINKING WATER SCHEME							
Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.4a	AS1	Number water treatment plants: providing full treatment	1	Count
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.1	AS2	Length water mains	11.1	km
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.4b	AS47	Capacity of water treatment plants	0.7	ML/day
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.7	AS48	Total potable water storage volume	1.816	ML
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.23	AS56	Volume water lost: potable water	6.3	ML
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG4.5	AS8	Water main breaks per 100 km water main	0	per 100 km water main
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG4.12	CS10	Water service complaints per 1000 connections	3.2	per 1000 connections
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG4.14	CS12	Water and sewerage billing and account complaints per 1000 connections	0	per 1000 connections
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG4.11	CS13	Water and sewerage complaints (all) per 1000 connections	3.2	per 1000 connections
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG4.7	CS17	Average frequency unplanned interruptions: water	0	per 1000 connections
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.13	CS2	Connected residential properties: water	0.26	000s
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.14	CS3	Connected non-residential properties: water	0.051	000s
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG4.8a	CS66	Percent CSS response target met: water incidents	100	%
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG4.10	CS9	Water quality complaints per 1000 connections	0	per 1000 connections
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG4.1(value)	PR3	Fixed charge: water value	520.8	\$/annum
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG4.1(text)	PR5	Fixed charge: water description	Water Access	Text

TIARO DRINKING WATER SCHEME

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.8	WA1	Volume water sourced: surface water	55.2	ML
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.9a	WA2	Volume water sourced: groundwater	NR	ML
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.5	WA201	Maximum daily demand	0.2	ML/day
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.21	WA223	Volume all water imported: internal and external	0	ML
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.22	WA224	Volume all water exported: internal and external	0	ML
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.6a	WA225	Volume potable water produced at a water treatment plant	47.6	ML
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.17a	WA32	Volume potable water supplied: residential	28.7	ML
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.18a	WA34	Volume potable water supplied: non-residential	10.6	ML
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.10	WA61	Volume water sourced: desalination marine water	NR	ML
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG1.12	WA7	Volume water sourced: all	55.2	ML

TIARO DRINKING WATER SECURITY							
Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.10a	WS11	Water restriction duration: PWCM	0	days
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.10b	WS12	Water restriction duration: Level 1	365	days
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.10c	WS13	Water restriction duration: Level 2	0	days
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.10d	WS14	Water restriction duration: Level 3	0	days
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.10e	WS15	Water restriction duration: Level 4	0	days
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.10f	WS16	Water restriction duration: Level 5	0	days
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.11a	WS17	Has asset management planning been undertaken in the last 10 yrs?	yes	yes/no
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.11b	WS18	Has drought management planning been undertaken in the last 10 yrs?	yes	yes/no
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.11c	WS19	Has water demand forecasts been developed or reviewed in the last 5 yrs?	yes	yes/no
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.11d	WS20	Has assessment of key capacity constraints of water infrastructure been undertaken in last 10 yrs?	yes	yes/no
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.11e	WS21	Has the timing for potential future supply augmentation been assessed in the last 10 yrs?	yes	yes/no
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.12	WS22	Months water supply remaining as at 30 June (KPI level)	5	1,2,3,4,5,6
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.13	WS23	Confidence water demand will be met: next 18 mths	high	high,fair,unsure,low,very low
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.14	WS24	Confidence water demand will be met: next 5 yrs	high	high,fair,unsure,low,very low
2023	Tiaro Town Potable Water Supply Area	Potable water scheme	QG2.3	WS3	Available contingency supplies	yes	yes/no

FRASER COAST REGION DRINKING WATER SCHEME AND SECURITY

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.8	WA1	Volume water sourced: surface water	10526.8	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.9a	WA2	Volume water sourced: groundwater	0	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.5	WA201	Maximum daily demand	37.3	ML/day
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.21	WA223	Volume all water imported: internal and external	0	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.22	WA224	Volume all water exported: internal and external	0	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.6a	WA225	Volume potable water produced at a water treatment plant	9463	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.11	WA26	Volume recycled sewage supplied: all	4999.4	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.17a	WA32	Volume potable water supplied: residential	6195.7	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.18a	WA34	Volume potable water supplied: non-residential	2236.4	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.10	WA61	Volume water sourced: desalination marine water	0	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.12	WA7	Volume water sourced: all	15526.2	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.17b	WA91	Volume raw-PT water supplied: residential	0	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.18b	WA92	Volume raw-PT water supplied: non-residential	527.6	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.20	WF1	Total full-time equivalent water+sewerage employees	160	FTEs
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.10a	WS11	Water restriction duration: PWCM	0	days
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.10b	WS12	Water restriction duration: Level 1	365	days

FRASER COAST REGION DRINKING WATER SCHEME AND SECURITY

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.10c	WS13	Water restriction duration: Level 2	0	days
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.10d	WS14	Water restriction duration: Level 3	0	days
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.10e	WS15	Water restriction duration: Level 4	0	days
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.10f	WS16	Water restriction duration: Level 5	0	days
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.11a	WS17	Has asset management planning been undertaken in the last 10 yrs?	yes	yes/no
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.11b	WS18	Has drought management planning been undertaken in the last 10 yrs?	yes	yes/no
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.11c	WS19	Has water demand forecasts been developed or reviewed in the last 5 yrs?	yes	yes/no
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.11d	WS20	Has assessment of key capacity constraints of water infrastructure been undertaken in last 10 yrs?	yes	yes/no
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.11e	WS21	Has the timing for potential future supply augmentation been assessed in the last 10 yrs?	yes	yes/no
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.12	WS22	Months water supply remaining as at 30 June (KPI level)	5	1,2,3,4,5,6
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.13	WS23	Confidence water demand will be met: next 18 mths	high	high,fair,unsure,low,very low
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.14	WS24	Confidence water demand will be met: next 5 yrs	fair	high,fair,unsure,low,very low
2023	Fraser Coast Regional Council WSP-wide	WSP	QG2.3	WS3	Available contingency supplies	yes	yes/no

MARYBOROUGH RECYCLED WATER SCHEME

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG1.1	AS2	Length water mains	17.7	km
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG4.5	AS8	Water main breaks per 100 km water main	0	per 100 km water main
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG4.12	CS10	Water service complaints per 1000 connections	0	per 1000 connections
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG4.14	CS12	Water and sewerage billing and account complaints per 1000 connections	0	per 1000 connections
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG4.11	CS13	Water and sewerage complaints (all) per 1000 connections	0	per 1000 connections
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG1.13	CS2	Connected residential properties: water	0	000s
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG1.14	CS3	Connected non-residential properties: water	0.046	000s
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG4.10	CS9	Water quality complaints per 1000 connections	0	per 1000 connections
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG4.1(value)	PR3	Fixed charge: water value	0	\$/annum
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG4.1(text)	PR5	Fixed charge: water description	0	Text
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG1.21	WA223	Volume all water imported: internal and external	0	ML
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG1.22	WA224	Volume all water exported: internal and external	0	ML
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG1.11	WA26	Volume recycled sewage supplied: all	1054.7	ML
2023	Maryborough Town Recycled Water Supply Area	Recycled water scheme	QG1.12	WA7	Volume water sourced: all	1054.7	ML

BURRUM HEADS RECYCLED WATER SCHEME

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG1.1	AS2	Length water mains	6.5	km
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG4.5	AS8	Water main breaks per 100 km water main	0	per 100 km water main
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG4.12	CS10	Water service complaints per 1000 connections	0	per 1000 connections
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG4.14	CS12	Water and sewerage billing and account complaints per 1000 connections	0	per 1000 connections
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG4.11	CS13	Water and sewerage complaints (all) per 1000 connections	0	per 1000 connections
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG1.13	CS2	Connected residential properties: water	0	000s
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG1.14	CS3	Connected non-residential properties: water	0.001	000s
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG4.10	CS9	Water quality complaints per 1000 connections	0	per 1000 connections
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG4.1(value)	PR3	Fixed charge: water value	0	\$/annum
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG4.1(text)	PR5	Fixed charge: water description	0	Text
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG1.21	WA223	Volume all water imported: internal and external	0	ML
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG1.22	WA224	Volume all water exported: internal and external	0	ML
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG1.11	WA26	Volume recycled sewage supplied: all	177	ML
2023	Burrum Heads effluent reuse scheme	Recycled water scheme	QG1.12	WA7	Volume water sourced: all	177	ML

HERVEY BAY RECYCLED WATER SCHEME

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG1.1	AS2	Length water mains	44.8	km
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG4.5	AS8	Water main breaks per 100 km water main	0	per 100 km water main
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG4.12	CS10	Water service complaints per 1000 connections	0	per 1000 connections
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG4.14	CS12	Water and sewerage billing and account complaints per 1000 connections	0	per 1000 connections
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG4.11	CS13	Water and sewerage complaints (all) per 1000 connections	0	per 1000 connections
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG1.13	CS2	Connected residential properties: water	0	000s
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG1.14	CS3	Connected non-residential properties: water	0.04	000s
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG4.10	CS9	Water quality complaints per 1000 connections	0	per 1000 connections
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG4.1(value)	PR3	Fixed charge: water value	0	\$/annum
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG4.1(text)	PR5	Fixed charge: water description	0	Text
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG1.21	WA223	Volume all water imported: internal and external	0	ML
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG1.22	WA224	Volume all water exported: internal and external	0	ML
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG1.11	WA26	Volume recycled sewage supplied: all	3703.6	ML
2023	Hervey Bay Town Recycled Water Supply Area	Recycled water scheme	QG1.12	WA7	Volume water sourced: all	3703.6	ML

HOWARD RECYCLED WATER SCHEME

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Howard effluent reuse scheme	Recycled water scheme	QG1.1	AS2	Length water mains	2.7	km
2023	Howard effluent reuse scheme	Recycled water scheme	QG4.5	AS8	Water main breaks per 100 km water main	0	per 100 km water main
2023	Howard effluent reuse scheme	Recycled water scheme	QG4.12	CS10	Water service complaints per 1000 connections	0	per 1000 connections
2023	Howard effluent reuse scheme	Recycled water scheme	QG4.14	CS12	Water and sewerage billing and account complaints per 1000 connections	0	per 1000 connections
2023	Howard effluent reuse scheme	Recycled water scheme	QG4.11	CS13	Water and sewerage complaints (all) per 1000 connections	0	per 1000 connections
2023	Howard effluent reuse scheme	Recycled water scheme	QG1.13	CS2	Connected residential properties: water	0	000s
2023	Howard effluent reuse scheme	Recycled water scheme	QG1.14	CS3	Connected non-residential properties: water	0.001	000s
2023	Howard effluent reuse scheme	Recycled water scheme	QG4.10	CS9	Water quality complaints per 1000 connections	0	per 1000 connections
2023	Howard effluent reuse scheme	Recycled water scheme	QG4.1(value)	PR3	Fixed charge: water value	0	\$/annum
2023	Howard effluent reuse scheme	Recycled water scheme	QG4.1(text)	PR5	Fixed charge: water description	0	Text
2023	Howard effluent reuse scheme	Recycled water scheme	QG1.21	WA223	Volume all water imported: internal and external	0	ML
2023	Howard effluent reuse scheme	Recycled water scheme	QG1.22	WA224	Volume all water exported: internal and external	0	ML
2023	Howard effluent reuse scheme	Recycled water scheme	QG1.11	WA26	Volume recycled sewage supplied: all	5.7	ML
2023	Howard effluent reuse scheme	Recycled water scheme	QG1.12	WA7	Volume water sourced: all	5.7	ML

TOOGOOM RECYCLED WATER SCHEME

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG1.1	AS2	Length water mains	0.6	km
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG4.5	AS8	Water main breaks per 100 km water main	0	per 100 km water main
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG4.12	CS10	Water service complaints per 1000 connections	0	per 1000 connections
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG4.14	CS12	Water and sewerage billing and account complaints per 1000 connections	0	per 1000 connections
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG4.11	CS13	Water and sewerage complaints (all) per 1000 connections	0	per 1000 connections
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG1.13	CS2	Connected residential properties: water	0	000s
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG1.14	CS3	Connected non-residential properties: water	0.002	000s
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG4.10	CS9	Water quality complaints per 1000 connections	0	per 1000 connections
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG4.1(value)	PR3	Fixed charge: water value	0	\$/annum
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG4.1(text)	PR5	Fixed charge: water description	0	Text
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG1.21	WA223	Volume all water imported: internal and external	0	ML
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG1.22	WA224	Volume all water exported: internal and external	0	ML
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG1.11	WA26	Volume recycled sewage supplied: all	46.9	ML
2023	Toogoom effluent reuse scheme	Recycled water scheme	QG1.12	WA7	Volume water sourced: all	46.9	ML

TORBANLEA RECYCLED WATER SCHEME

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG1.1	AS2	Length water mains	2.2	km
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG4.5	AS8	Water main breaks per 100 km water main	0	per 100 km water main
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG4.12	CS10	Water service complaints per 1000 connections	0	per 1000 connections
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG4.14	CS12	Water and sewerage billing and account complaints per 1000 connections	0	per 1000 connections
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG4.11	CS13	Water and sewerage complaints (all) per 1000 connections	0	per 1000 connections
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG1.13	CS2	Connected residential properties: water	0	000s
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG1.14	CS3	Connected non-residential properties: water	0.003	000s
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG4.10	CS9	Water quality complaints per 1000 connections	0	per 1000 connections
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG4.1(value)	PR3	Fixed charge: water value	0	\$/annum
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG4.1(text)	PR5	Fixed charge: water description	0	Text
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG1.21	WA223	Volume all water imported: internal and external	0	ML
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG1.22	WA224	Volume all water exported: internal and external	0	ML
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG1.11	WA26	Volume recycled sewage supplied: all	11.5	ML
2023	Torbanlea effluent reuse scheme	Recycled water scheme	QG1.12	WA7	Volume water sourced: all	11.5	ML

MARYBOROUGH SEWERAGE SCHEME

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Maryborough Town Sewerage Service Area	Sewerage scheme	QG4.6	AS39	Sewerage mains breaks/chokes per 100 km sewer main	3.6	per 100 km sewer mains
2023	Maryborough Town Sewerage Service Area	Sewerage scheme	QG1.3	AS4	Number sewage treatment plants	1	Count
2023	Maryborough Town Sewerage Service Area	Sewerage scheme	QG1.2	AS5	Length sewerage mains and channels	251.4	km
2023	Maryborough Town Sewerage Service Area	Sewerage scheme	QG4.13	CS11	Sewerage service complaints per 1000 connections	5.7	per 1000 connections
2023	Maryborough Town Sewerage Service Area	Sewerage scheme	QG4.14	CS12	Water and sewerage billing and account complaints per 1000 connections	0	per 1000 connections
2023	Maryborough Town Sewerage Service Area	Sewerage scheme	QG4.11	CS13	Water and sewerage complaints (all) per 1000 connections	6.2	per 1000 connections
2023	Maryborough Town Sewerage Service Area	Sewerage scheme	QG1.15	CS6	Connected residential properties: sewerage	9.009	000s
2023	Maryborough Town Sewerage Service Area	Sewerage scheme	QG4.9a	CS65	Percent CSS response target met: sewerage incidents	100	%
2023	Maryborough Town Sewerage Service Area	Sewerage scheme	QG1.16	CS7	Connected non-residential properties: sewerage	1.175	000s
2023	Maryborough Town Sewerage Service Area	Sewerage scheme	QG4.2(value)	PR31	Fixed charge: sewerage value	816.9	\$/annum
2023	Maryborough Town Sewerage Service Area	Sewerage scheme	QG4.2(text)	PR40	Fixed charge: sewerage description	Sewer Access Charge	Text

HERVEY BAY SEWERAGE SCHEME

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Hervey Bay Town Sewerage Service Area	Sewerage scheme	QG4.6	AS39	Sewerage mains breaks/chokes per 100 km sewer main	2.1	per 100 km sewer mains
2023	Hervey Bay Town Sewerage Service Area	Sewerage scheme	QG1.3	AS4	Number sewage treatment plants	7	Count
2023	Hervey Bay Town Sewerage Service Area	Sewerage scheme	QG1.2	AS5	Length sewerage mains and channels	568.6	km
2023	Hervey Bay Town Sewerage Service Area	Sewerage scheme	QG4.13	CS11	Sewerage service complaints per 1000 connections	4.6	per 1000 connections
2023	Hervey Bay Town Sewerage Service Area	Sewerage scheme	QG4.14	CS12	Water and sewerage billing and account complaints per 1000 connections	0	per 1000 connections
2023	Hervey Bay Town Sewerage Service Area	Sewerage scheme	QG4.11	CS13	Water and sewerage complaints (all) per 1000 connections	4.7	per 1000 connections
2023	Hervey Bay Town Sewerage Service Area	Sewerage scheme	QG1.15	CS6	Connected residential properties: sewerage	22.794	000s
2023	Hervey Bay Town Sewerage Service Area	Sewerage scheme	QG4.9a	CS65	Percent CSS response target met: sewerage incidents	100	%
2023	Hervey Bay Town Sewerage Service Area	Sewerage scheme	QG1.16	CS7	Connected non-residential properties: sewerage	2.424	000s
2023	Hervey Bay Town Sewerage Service Area	Sewerage scheme	QG4.2(value)	PR31	Fixed charge: sewerage value	816.9	\$/annum
2023	Hervey Bay Town Sewerage Service Area	Sewerage scheme	QG4.2(text)	PR40	Fixed charge: sewerage description	Sewer Access Charge	Text

FRASER COAST REGION COMBINED WATER AND SEWERAGE SCHEMES PERFORMANCE

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.1	AS2	Length water mains	1212.8	km
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.13	CS2	Connected residential properties: water	38.259	000s
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.14	CS3	Connected non-residential properties: water	3.617	000s
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.15	CS6	Connected residential properties: sewerage	31.803	000s
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.16	CS7	Connected non-residential properties: sewerage	3.599	000s
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.2	AS5	Length sewerage mains and channels	819.9	km
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.23	AS56	Volume water lost: potable water	878.6	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.3	AS4	Number sewage treatment plants	8	Count
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.4a	AS1	Number water treatment plants: providing full treatment	4	Count
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.4b	AS47	Capacity of water treatment plants	72.7	ML/day
2023	Fraser Coast Regional Council WSP-wide	WSP	QG1.7	AS48	Total potable water storage volume	103.829	ML
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.10	CS9	Water quality complaints per 1000 connections	1.5	per 1000 connections
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.11	CS13	Water and sewerage complaints (all) per 1000 connections	13.6	per 1000 connections
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.12	CS10	Water service complaints per 1000 connections	7.5	per 1000 connections
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.13	CS11	Sewerage service complaints per 1000 connections	4.9	per 1000 connections
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.14	CS12	Water and sewerage billing and account complaints per 1000 connections	0	per 1000 connections

FRASER COAST REGION COMBINED WATER AND SEWERAGE SCHEMES PERFORMANCE

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.5	AS8	Water main breaks per 100 km water main	7.3	per 100 km water main
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.6	AS39	Sewerage mains breaks/chokes per 100 km sewer main	2.6	per 100 km sewer mains
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.7	CS17	Average frequency unplanned interruptions: water	28.4	per 1000 connections
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.8a	CS66	Percent CSS response target met: water incidents	100	%
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.9a	CS65	Percent CSS response target met: sewerage incidents	100	%

FRASER COAST REGION COMBINED WATER AND SEWERAGE SCHEMES FINANCIAL PERFORMANCE

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.9	FN1	Revenue: all (NPR) water	48013	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.6	FN10	Nominal written down replacement cost: fixed sewerage assets	488402	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.11	FN11	Costs: operating water per connection	549.17	\$/connection
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.12	FN12	Costs: operating sewerage per connection	519.26	\$/connection
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.1	FN14	Capital expenditure: water supply	9098	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.2	FN15	Capital expenditure: sewerage	7071	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.10	FN2	Revenue: all (NPR) sewerage	52218	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.3	FN26	Capital works grants: water	746	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.4	FN27	Capital works grants: sewerage	563	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.11a	FN32	Costs: operating water (NPR)	22997	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.12a	FN33	Costs: operating sewerage	18383	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.21	FN49	Costs: any other water	15667	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.22	FN50	Costs: any other sewerage	14667	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.7	FN74	Current replacement costs: fixed water assets	879591	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.8	FN75	Current replacement costs: fixed sewerage assets	828928	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.13	FN76	Costs: maintenance water	21650	\$,000

FRASER COAST REGION COMBINED WATER AND SEWERAGE SCHEMES FINANCIAL PERFORMANCE

Year	Scheme Name	Scheme Type	KPI Code	SWIM Code	Indicator Title	Value	Unit
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.14	FN77	Costs: maintenance sewerage	16904	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.15	FN78	Current cost depreciation: water	14472	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.16	FN79	Current cost depreciation: sewerage	15232	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.17	FN80	Previous 5 year average annual renewals expenditure: water	4638	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.18	FN81	Previous 5 year average annual renewals expenditure: sewerage	5169	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.19	FN82	Forecast 5 year average annual renewals expenditure: water	7602	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.20	FN83	Forecast 5 year average annual renewals expenditure: sewerage	7069	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG3.5	FN9	Nominal written down replacement cost: fixed water assets	498677	\$,000
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.1(text)	PR5	Fixed charge: water description	Water Access	Text
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.1(value)	PR3	Fixed charge: water value	520.8	\$/annum
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.2(text)	PR40	Fixed charge: sewerage description	Sewer Access Charge	Text
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.2(value)	PR31	Fixed charge: sewerage value	816.9	\$/annum
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.3	PR47	Annual bill based on 200kL/a: water+sewerage	1745.7	\$
2023	Fraser Coast Regional Council WSP-wide	WSP	QG4.4	PR48	Typical residential bill: water+sewerage	1667.98	\$